




Plan View - Ductwork Layout - Proposal Drawing - XXXXXXXXXXXXXXXXXXXX School Welding Classroom

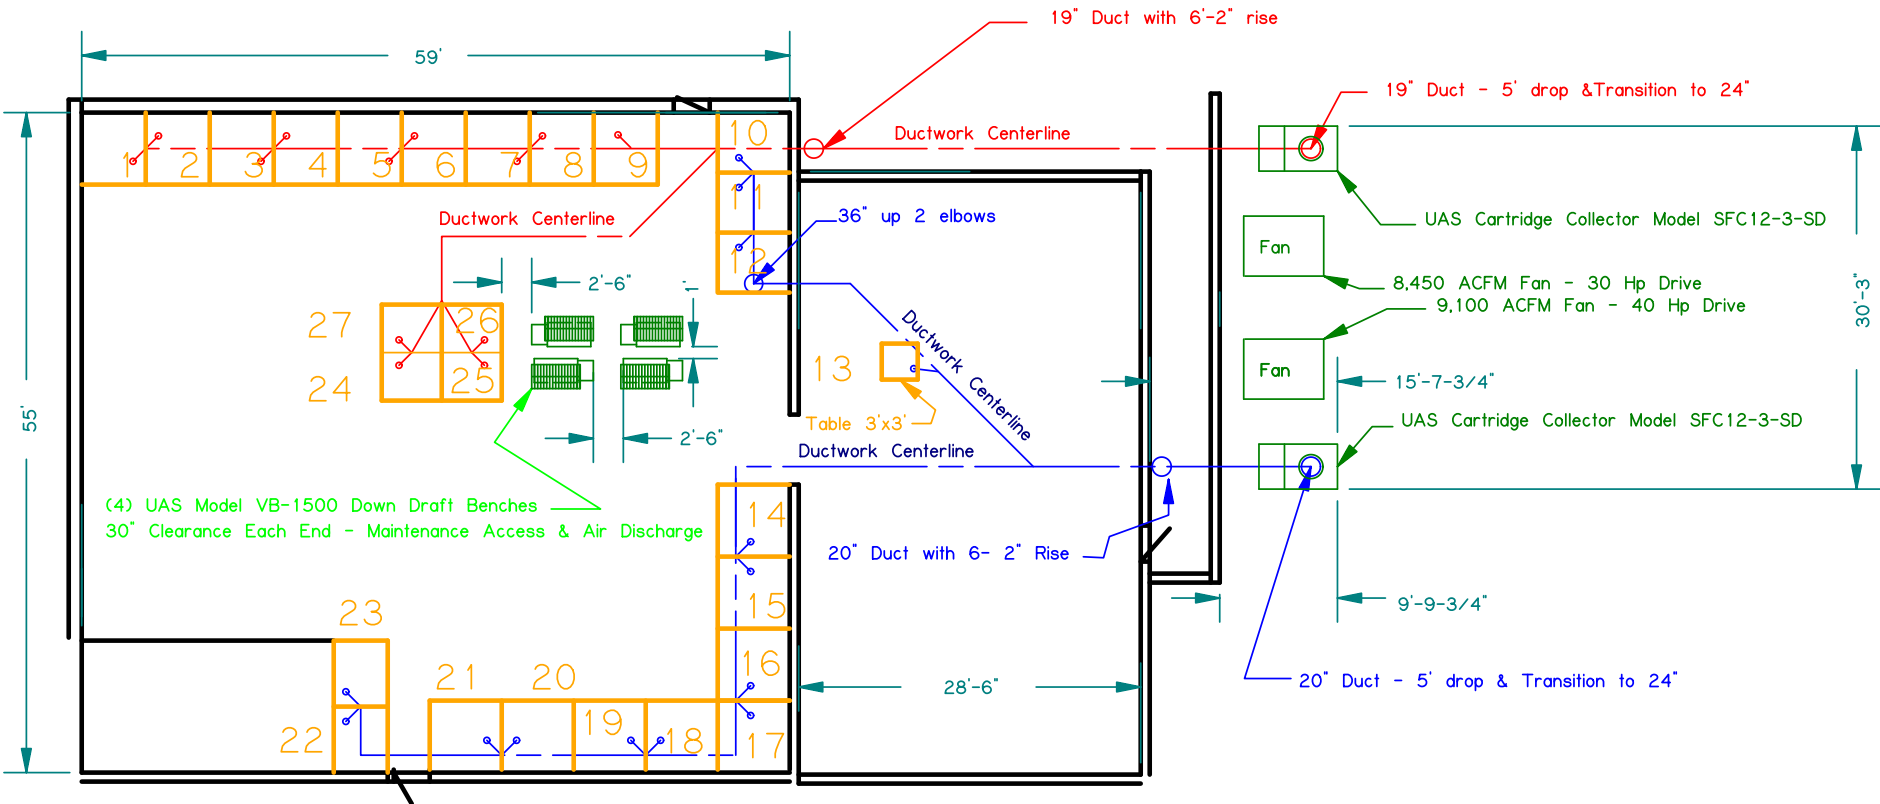

View of Internal Wall Duct Penetrations

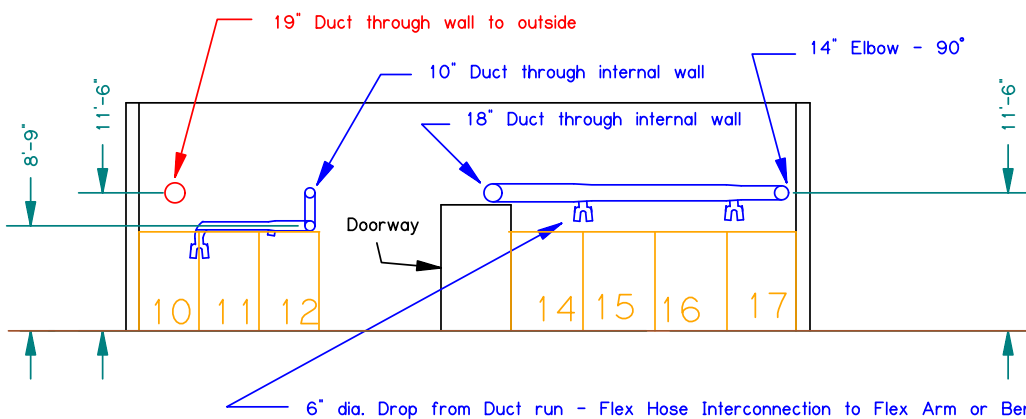

View of External Dust Collectors

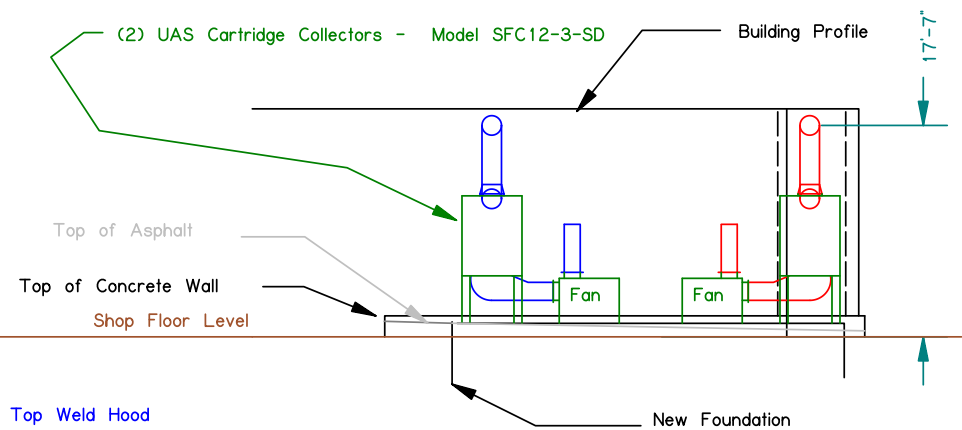

- 1) Each Booth served through 6" diameter drop of Flex Hose from Duct 'pants leg' or branch entry.
- 2) Booths 1 to 9 & 14 to 21 served with 6" dia. x 7' long flex arm. Others with bench top hood
- 3) This is a Preliminary Drawing Not Field nor Back Checked. Do NOT use for construction !
- 4) 650 ACFM per Booth at Weld Stations. 1,500 ACFM at Each Down Draft Bench

27, JAN 2008